



To Download your National Grid Gas Usage:


Step 1: Login to your National Grid Gas Account:

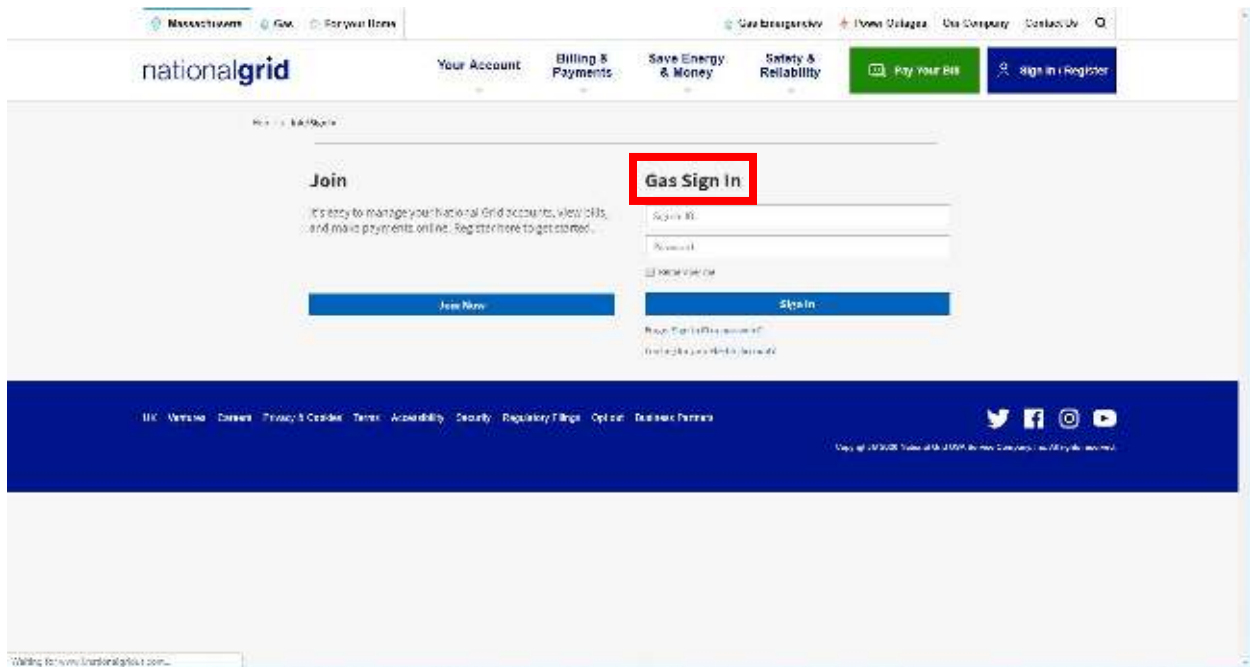


Step 2: Select “Usage History, Current Bill & Energy Use Analysis”

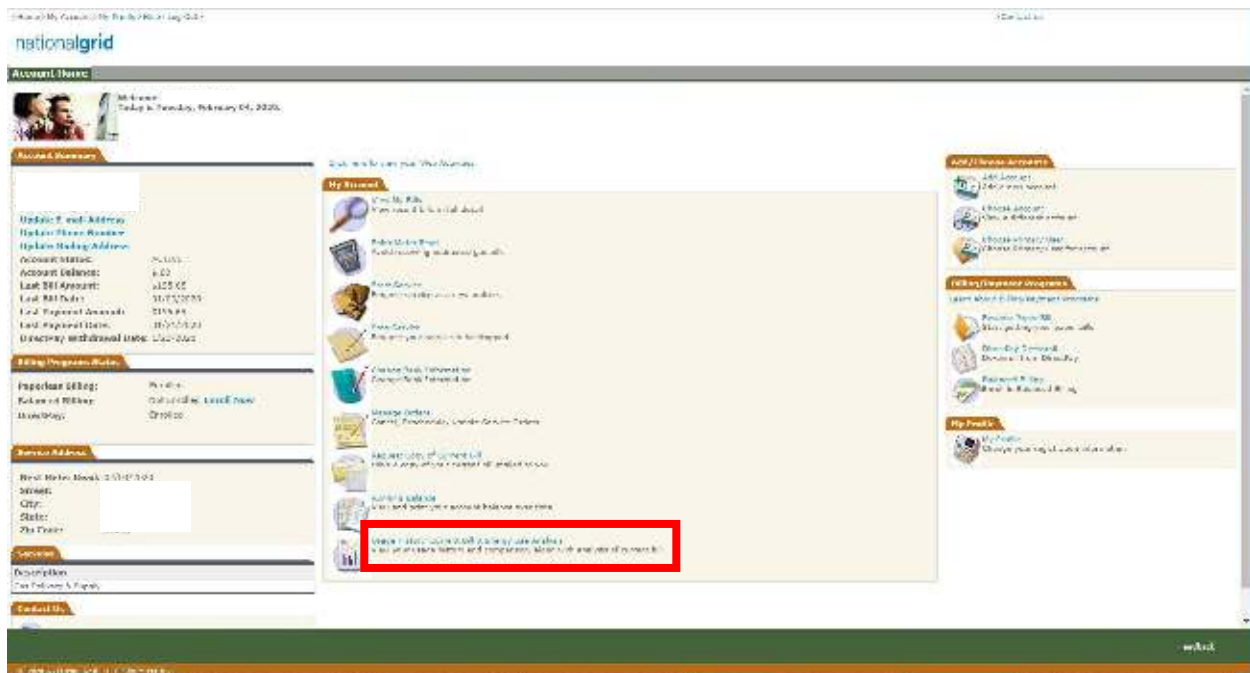

Step 3: Select “Export” to download gas usage.

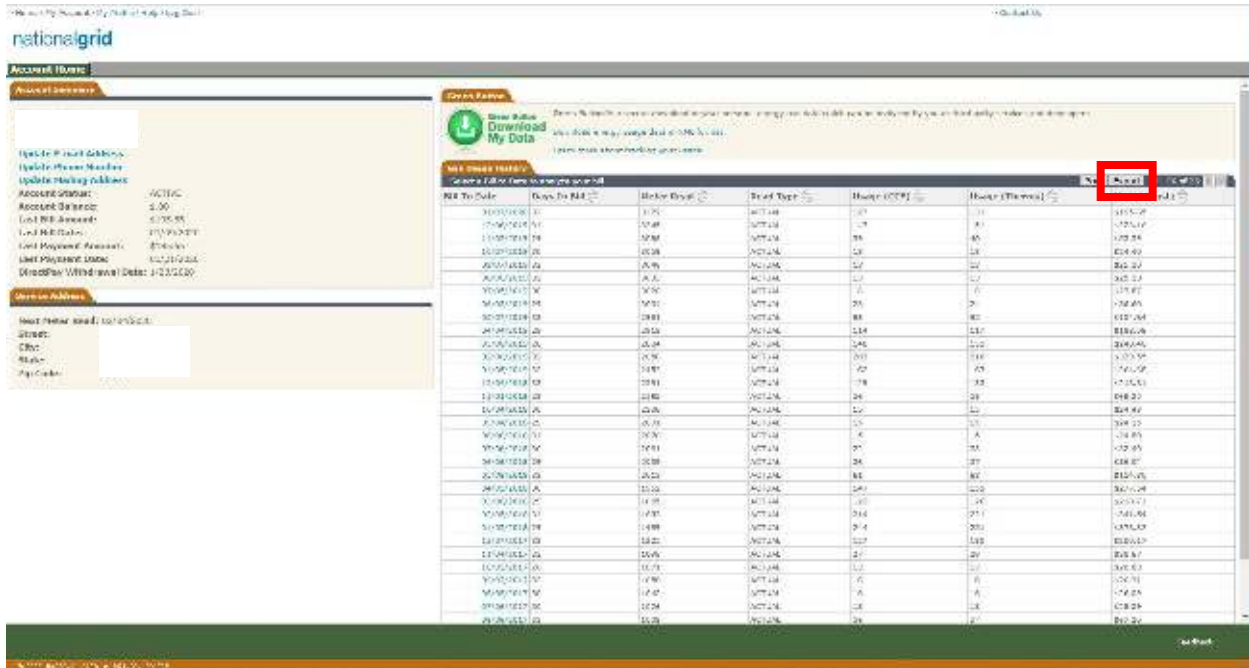

Step 4: Make sure “All Rows in Current Query” and “Tab Delimited Text File” are selected and click “Next.”

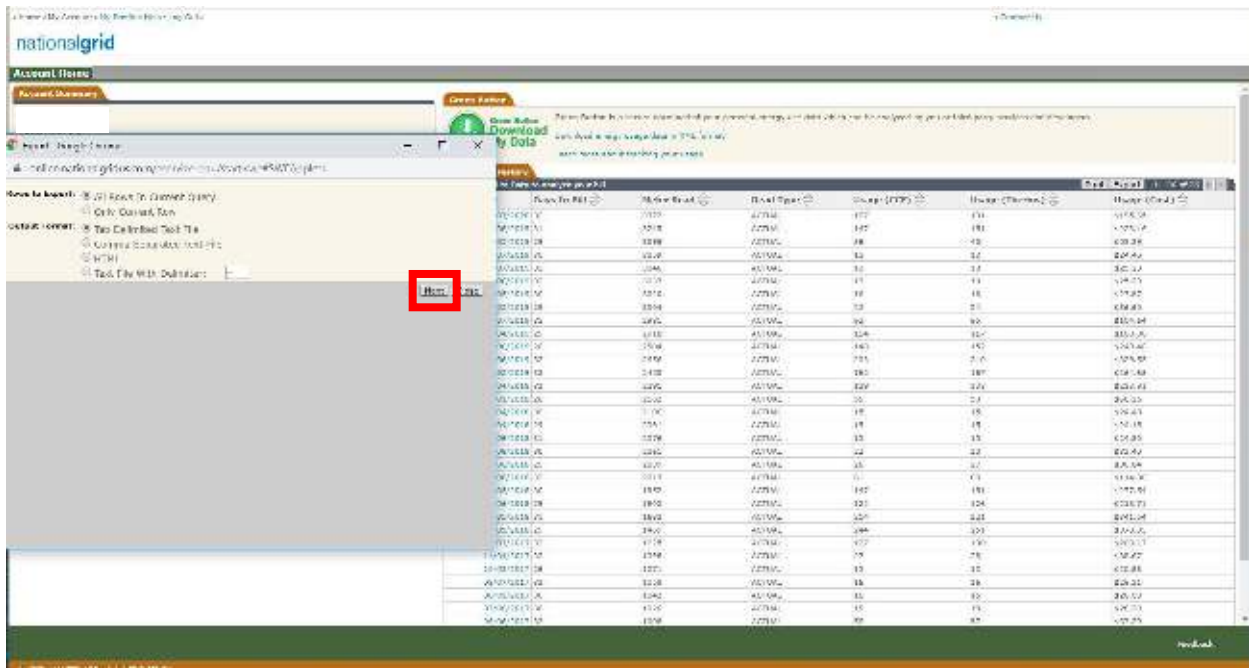

Step 5: Upload the downloaded CSV File with your Whole Home Pilot Application.

Order Date	Days in Bill	Merchant	Card Type	Charge (GBP)	Charge (Therms)	Usage (Cost)
1/7/2012	30	3272 A77L4L		127	124	2035.85
1/10/2012	30	3281 A77L4L		141	140	2174.76
1/13/2012	30	3288 A77L4L		154	150	2324.28
1/17/2012	30	3295 A77L4L		111	110	1731.40
1/21/2012	30	3288 A77L4L		111	110	1731.40
1/24/2012	30	3295 A77L4L		110	109	1724.20
1/28/2012	30	3288 A77L4L		110	109	1724.20
1/31/2012	30	3295 A77L4L		110	109	1724.20
2/4/2012	30	3288 A77L4L		110	109	1724.20
2/7/2012	30	3295 A77L4L		110	109	1724.20
2/11/2012	30	3288 A77L4L		110	109	1724.20
2/14/2012	30	3295 A77L4L		110	109	1724.20
2/18/2012	30	3288 A77L4L		110	109	1724.20
2/21/2012	30	3295 A77L4L		110	109	1724.20
2/25/2012	30	3288 A77L4L		110	109	1724.20
2/28/2012	30	3295 A77L4L		110	109	1724.20
3/3/2012	30	3288 A77L4L		110	109	1724.20
3/6/2012	30	3295 A77L4L		110	109	1724.20
3/10/2012	30	3288 A77L4L		110	109	1724.20
3/13/2012	30	3295 A77L4L		110	109	1724.20
3/17/2012	30	3288 A77L4L		110	109	1724.20
3/20/2012	30	3295 A77L4L		110	109	1724.20
3/24/2012	30	3288 A77L4L		110	109	1724.20
3/27/2012	30	3295 A77L4L		110	109	1724.20
3/31/2012	30	3288 A77L4L		110	109	1724.20
4/3/2012	30	3295 A77L4L		110	109	1724.20
4/7/2012	30	3288 A77L4L		110	109	1724.20
4/10/2012	30	3295 A77L4L		110	109	1724.20
4/14/2012	30	3288 A77L4L		110	109	1724.20
4/17/2012	30	3295 A77L4L		110	109	1724.20
4/21/2012	30	3288 A77L4L		110	109	1724.20
4/24/2012	30	3295 A77L4L		110	109	1724.20
4/28/2012	30	3288 A77L4L		110	109	1724.20
5/1/2012	30	3295 A77L4L		110	109	1724.20
5/5/2012	30	3288 A77L4L		110	109	1724.20
5/8/2012	30	3295 A77L4L		110	109	1724.20
5/12/2012	30	3288 A77L4L		110	109	1724.20
5/15/2012	30	3295 A77L4L		110	109	1724.20
5/19/2012	30	3288 A77L4L		110	109	1724.20
5/22/2012	30	3295 A77L4L		110	109	1724.20
5/26/2012	30	3288 A77L4L		110	109	1724.20
5/29/2012	30	3295 A77L4L		110	109	1724.20
6/2/2012	30	3288 A77L4L		110	109	1724.20
6/5/2012	30	3295 A77L4L		110	109	1724.20
6/9/2012	30	3288 A77L4L		110	109	1724.20
6/12/2012	30	3295 A77L4L		110	109	1724.20
6/16/2012	30	3288 A77L4L		110	109	1724.20
6/19/2012	30	3295 A77L4L		110	109	1724.20
6/23/2012	30	3288 A77L4L		110	109	1724.20
6/26/2012	30	3295 A77L4L		110	109	1724.20
6/30/2012	30	3288 A77L4L		110	109	1724.20
7/3/2012	30	3295 A77L4L		110	109	1724.20
7/7/2012	30	3288 A77L4L		110	109	1724.20
7/10/2012	30	3295 A77L4L		110	109	1724.20
7/14/2012	30	3288 A77L4L		110	109	1724.20
7/17/2012	30	3295 A77L4L		110	109	1724.20
7/21/2012	30	3288 A77L4L		110	109	1724.20
7/24/2012	30	3295 A77L4L		110	109	1724.20
7/28/2012	30	3288 A77L4L		110	109	1724.20
7/31/2012	30	3295 A77L4L		110	109	1724.20
8/4/2012	30	3288 A77L4L		110	109	1724.20
8/7/2012	30	3295 A77L4L		110	109	1724.20
8/11/2012	30	3288 A77L4L		110	109	1724.20
8/14/2012	30	3295 A77L4L		110	109	1724.20
8/18/2012	30	3288 A77L4L		110	109	1724.20
8/21/2012	30	3295 A77L4L		110	109	1724.20
8/25/2012	30	3288 A77L4L		110	109	1724.20
8/28/2012	30	3295 A77L4L		110	109	1724.20
8/31/2012	30	3288 A77L4L		110	109	1724.20
9/4/2012	30	3295 A77L4L		110	109	1724.20
9/7/2012	30	3288 A77L4L		110	109	1724.20
9/11/2012	30	3295 A77L4L		110	109	1724.20
9/14/2012	30	3288 A77L4L		110	109	1724.20
9/18/2012	30	3295 A77L4L		110	109	1724.20
9/21/2012	30	3288 A77L4L		110	109	1724.20
9/25/2012	30	3295 A77L4L		110	109	1724.20
9/28/2012	30	3288 A77L4L		110	109	1724.20
9/30/2012	30	3295 A77L4L		110	109	1724.20
10/3/2012	30	3288 A77L4L		110	109	1724.20
10/6/2012	30	3295 A77L4L		110	109	1724.20
10/10/2012	30	3288 A77L4L		110	109	1724.20
10/13/2012	30	3295 A77L4L		110	109	1724.20
10/17/2012	30	3288 A77L4L		110	109	1724.20
10/20/2012	30	3295 A77L4L		110	109	1724.20
10/24/2012	30	3288 A77L4L		110	109	1724.20
10/27/2012	30	3295 A77L4L		110	109	1724.20
10/31/2012	30	3288 A77L4L		110	109	1724.20
11/3/2012	30	3295 A77L4L		110	109	1724.20
11/7/2012	30	3288 A77L4L		110	109	1724.20
11/10/2012	30	3295 A77L4L		110	109	1724.20
11/14/2012	30	3288 A77L4L		110	109	1724.20
11/17/2012	30	3295 A77L4L		110	109	1724.20
11/21/2012	30	3288 A77L4L		110	109	1724.20
11/24/2012	30	3295 A77L4L		110	109	1724.20
11/28/2012	30	3288 A77L4L		110	109	1724.20
11/30/2012	30	3295 A77L4L		110	109	1724.20
12/3/2012	30	3288 A77L4L		110	109	1724.20
12/6/2012	30	3295 A77L4L		110	109	1724.20
12/10/2012	30	3288 A77L4L		110	109	1724.20
12/13/2012	30	3295 A77L4L		110	109	1724.20
12/17/2012	30	3288 A77L4L		110	109	1724.20
12/20/2012	30	3295 A77L4L		110	109	1724.20
12/24/2012	30	3288 A77L4L		110	109	1724.20
12/27/2012	30	3295 A77L4L		110	109	1724.20
12/31/2012	30	3288 A77L4L		110	109	1724.20